

CENTRAL INTELLIGENCE AGENCY

REPORT NO. [REDACTED]

INFORMATION REPORT

CD NO.

25X1A

COUNTRY USSR (Leningrad Oblast)

DATE DISTR. 18 Feb. 1952

SUBJECT Power Plant at Slantsy

NO. OF PAGES 1

PLACE ACQUIRED 25X1A

NO. OF ENCLS. 1
(LISTED BELOW)

25X1A

DATE OF INFO.

SUPPLEMENT TO REPORT NO. [REDACTED]

25X1X

1. Location

On the southwest border of Slantsy (28°03'E/59°05'N), Leningrad Oblast, south of the Kirova mine, north of the railroad station, between the road to Narva and the small river Plyussa. For location see Annex.

2. Plant Installations

The power plant was destroyed during the war but was reconstructed and put into operation during the time of observation. There is only one large building, a concrete structure, 81 x 16 meters, with three smokestacks, housing the boiler section, turbine section and switching station. Source observed six oil-slate-fueled steam boilers driving three turbines with three generators which had been dismantled in Estonia. The installation of a fourth turbine was planned. Two large open-air transformers of US origin and one (Diesel) charging unit with two US generators were outside the building. A US mobile railroad power station was standing on the tracks beside the power plant.*

3. Work Force

No details available.

4. Capacity

- a. Three 3,000 kw generators in the plant
- b. Diesel charging unit with two generators, each 3,000 kws
- c. Mobile railroad power station, 3,000 kws.

Total capacity, auxiliary generators included, 18,000 kws.

25X1A

* [REDACTED] Comment: The presence of the mobile railroad power station beside the power plant was confirmed by two other sources.

ILLEGIB


CONFIDENTIAL

25X1

CENTRAL INTELLIGENCE AGENCY

Attachment

25X1A

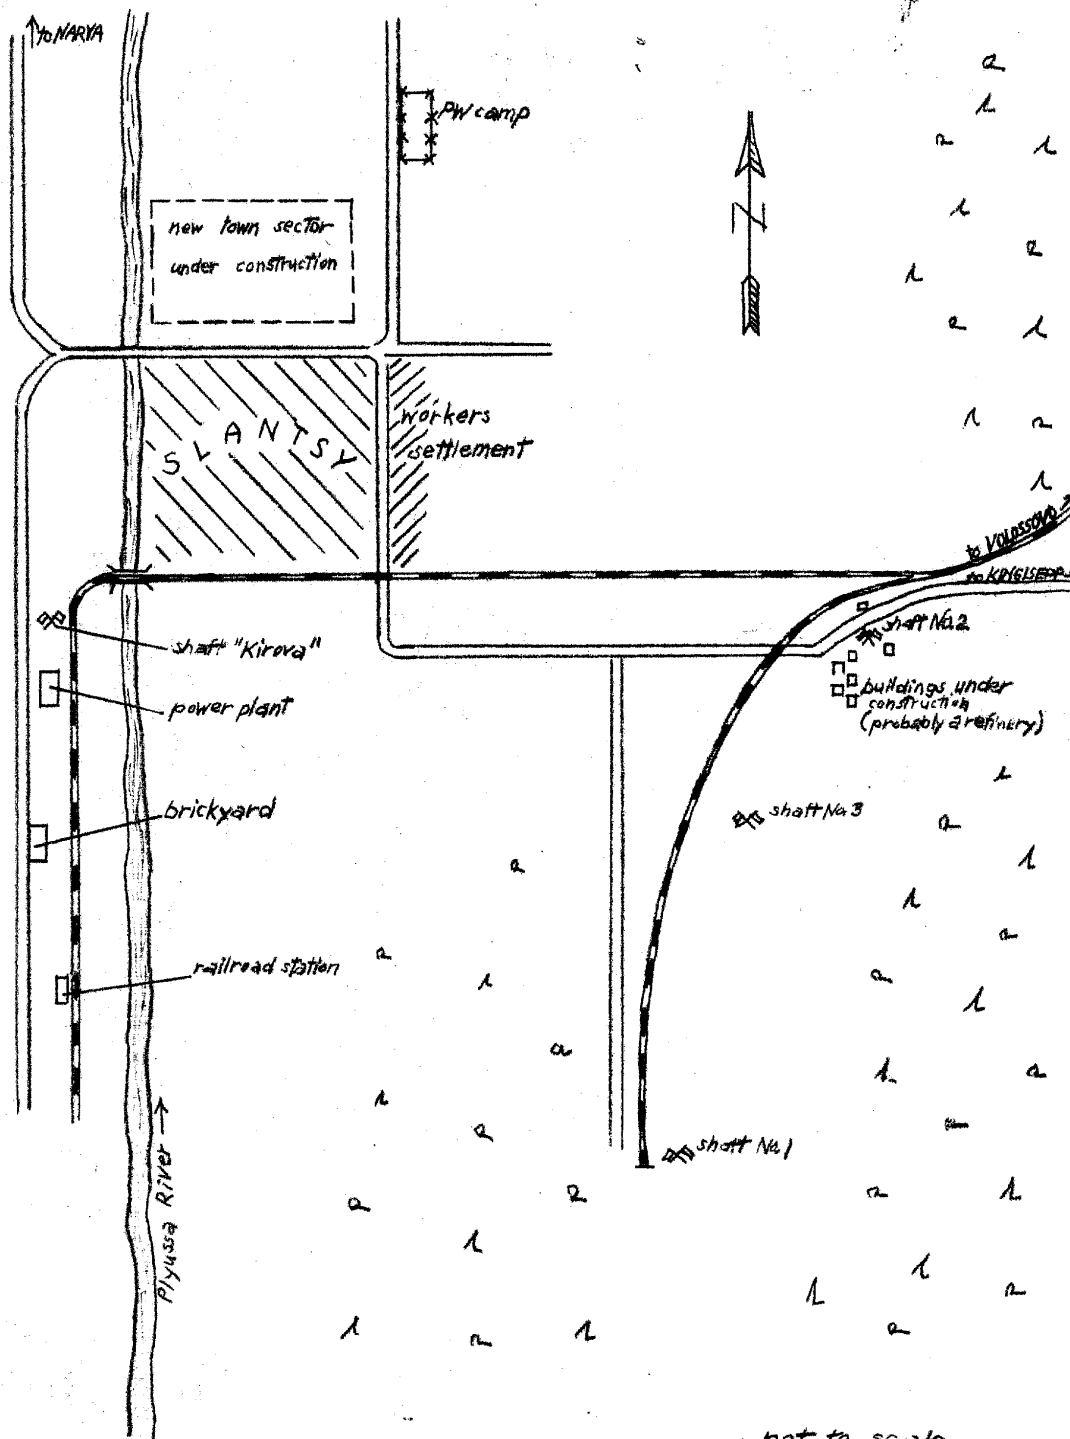

not to scale

CONFIDENTIAL

25X1

Document No. 9

No Change in Class. ☐

Declassified

Class. Changed To: TS S ☒

Auth.: HR 70-2

Date: 10 SEP 1979

25X1